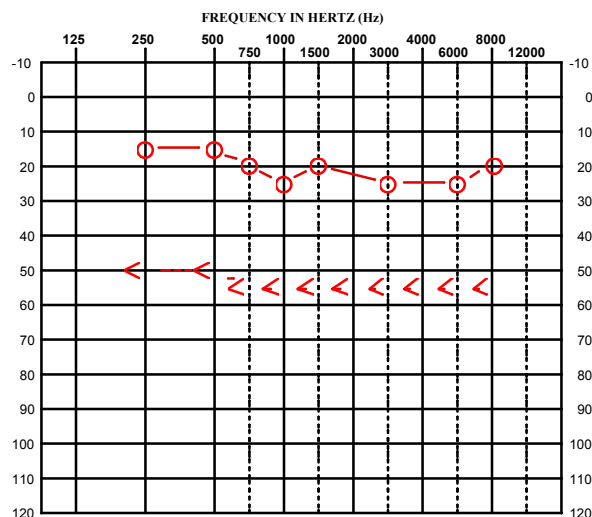




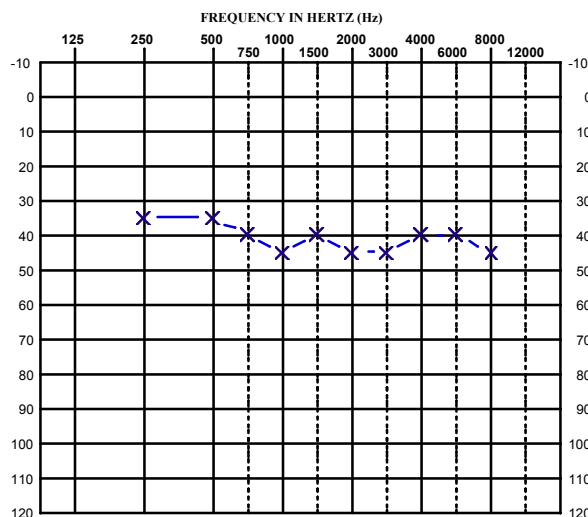
Audiogram

Patient Identifier **1234567**  
 NAME **Able, Denny**  
 D.O.B. **09/02/1941**  
 Audiologist **John Doe, Au.D.**  
 Physician  
 Date of Service **01/06/2005**

**RIGHT EAR**

Air Conduction	Right	Left
Unmasked	○	×
Masked	△	□
Bone Conduction		
Unmasked	◁	▷
Masked	◁	▷
Sound Field		
Unaided - Aided	S	A
Comfort Level		
Maximum	MC	MC
Uncomfortable	UC	UC
Reflexes		
Contra	↖	↗
Ipsi	↘	↙
Commented	C / P / V	

Audiometer:  
 GSI 61  
Transducer:  
 TDH-50 Phones  
Method:  
 Conventional  
Reliability:  
 Good

**LEFT EAR****SPEECH AUDIOMETRY**

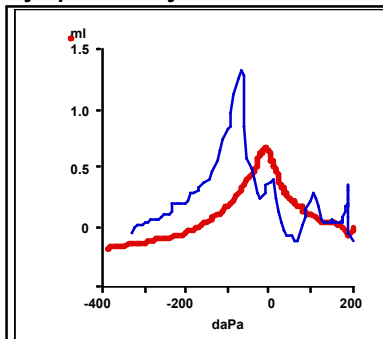
\* = Masked

R	SRT	SDT	%	HL	MLV/CD	TEST
	20	25	20	* 30	LV	Maryland CNC

**SPEECH AUDIOMETRY**

\* = Masked

L	SRT	SDT	%	HL	MLV/CD	TEST
	30	35	1	2	LV	WD 25

**Tympanometry**

Thick (red) - right, Thin (blue) - left

	Right	Left
Probe Tone (Hz)	226	226
Ear Canal Volume	1.30	1.60
Peak Admittance (ml)	0.70	1.40
Peak pressure (daPa)	15	-45
Curve Type	A	As

	Acoustic Reflexes @ 1000 Hz		Reflex Decay
	Stim Right	Stim Left	+ / -
Probe Right	CNT		-
Probe Left	95	UdB	

Abs- Absent CNT- Could Not Test UdB- Undefined decibel level

**Notes**

This is a test of the text measurements.

Wound care instructions: 1) Keep steri-strips dry for first 24 hours, then you can let water and soap run over them. Just gently pat them dry afterwards. 2) The steri-strips should stay on for a week. After that you can remove them whenever you want. They will gradually peel off and typically fall off by themselves the second week after surgery. You can just trim the edges as they come up during the first week.

Additional Word Rec Trials: Condition, Test Measure, %, Level

Monaural Right, Maryland CNC / REC, 50%, 50 dB

Monaural Right, NU-6 / LV, 90%, 70 dB

Monaural Right, NU-6 / REC, 40%, 90 dB

Unaided, W-22 / REC, 50%, 25 dB

Monaural Left, WD 25 / REC, 3%, 4 dB

Monaural Left, WD 50 / LV, 5%, 6 dB

Monaural Left, WD 50 / REC, 7%, \* 8 dB

Additional SAT Tests: Condition, dB

Aided Right, 55 dB

# CONTINUED NOTES

Aided Left , 65 dB  
Aided Bilateral , 75 dB  
Additional SRT Tests: Condition, dB  
Aided Right , 50 dB  
Aided Left , 60 dB  
Aided Right , NR dB

EXAMINER SIGNATURE

Electronically signed by  
Bilbo Baggins2 12: AM

Date

01/06/2005

Patient Identifier 1234567

NAME Able, Denny

D.O.B. 09/02/1941

AUDIOLOGIC EVALUATION